


Standard Commercial UV Light System

The Standard Commercial UV System features high quality water-resistant UV-C lamps with convenient "L" mounting brackets and a heavy duty multi-voltage water-resistant 120-277 VAC power supply. Choose from a full range of lamp models & sizes, 1 or 2 year effective life, normal or high output for surface/air treatment or intensive air treatment. Model# TUVC-xx





Tubular Rack System (TRS)

The Tubular Rack System makes installation easy. It includes all the clamps and mounting hardware necessary for mounting using standard 1/2" EMT tubing (optional custom steel tubing available). Will work with all Commercial Series lamp types and sizes.
Model# TUVC-TRS-xx



APCO Rack System

Our most advanced commercial system features our award-winning APCO gas-phase air purification technology. APCO carbon cells react with UV-C light to capture and neutralize odor-causing and potentially toxic VOCs. Proper use

of the APCO Rack System can reduce the amount of outside air needed for ventilation according to ASHRAE Standard 62.1.

Model# TUVC-APCO-xx





Lamp Sizes*

Lamps are available in standard or high output. *Not all lamps fit all models.

New 18"

New 24"

46"

60"

Power Supply

Commercial Series power supplies are 110-277 VAC, and include a toggle switch and replaceable fuse.





Environmental Surface Disinfection System (ESDS)

The ESDS disinfects surfaces in unoccupied rooms. It is a ceiling-mounted metal fixture with high-output germicidal UV-C lights that features an internal electronic power supply

and door interlock safety switches and other optional safety accessories including infrared motion detectors.

ESDS comes with 1 or 2 shatter-proof Teflon coated high-output 2 year (17,000 hrs) UV-C lamps and a 120 or 230 VAC power supply.

Model# TUVC-ESDS-xx

Airborne Duct System (ADS)

Airborne germicidal disinfection is ideal for hospitals and similar applications. ADS is installed in HVAC ducts to maximize exposure time with the air and features high-output lamps for maximum airborne kill. Choose grid or radial configuration. Uses 2-6 lamps depending on duct width, height and CFM. Model# TUVC-ADS-x



Reduce ice machine maintenance costs and liability risks with Ice UV and Ice UV Mini. Compact UV-C lamps are designed to produce just the right amount of UV-C light; enough to kill germs in ice machines without damaging plastic materials inside. Both products offer high and low voltage options.

Model# TUV-ICE-x Model# TUV-ICE-MINI-x



Control Box THVC-CRY

FRESH-AIRE UV



(TUV-ICE-x)



Accessories

UV-C Radiometer

TUVC-RAD-100DL

Get the most out of your commercial UV installation with Fresh-Aire UV accessories. They include cable extensions, additional mounting hardware, safety interlock switches, UV-C radiometers, control boxes, etc.





ADS in Duct

Tight-Fit Kit™

Realize the benefits of germicidal UV light in fan coil units and PTACs. Features a lowprofile lamp with metal shield and convenient mounting magnet. Options include 18-32 or 110-277 VAC power supplies and 1 or 2 year UV-C lamps.

Model# TUV-TFK-x





WWW.FRESHAIREUV.COM







Commercial UVGI System Configuration Guidelines

This guide is intended to make the process of commercial UVGI system configuration easy and accurate. Following are product descriptions, coil sizing examples and important information such as:

- Fresh-Aire UV® Commercial Series UVC lamp types
- · Power supply descriptions and part numbers
- Descriptions of Fresh-Aire UV® Commercial Series products
- Guide to Fresh-Aire UV® Commercial Series part numbers
- · Coil sizing examples
- UVGI Accessories

BlueCalc™

Fresh-Aire UV® offers commercial building managers and contractors a free online UVGI System Design Analysis Service based on our proprietary BlueCalc™ UVC light modelling software. Using this convenient service ensures an accurate UVGI system configuration. Go to www.freshaireuv.com/commercial-bluecalc.html

Lamps

Fresh-Aire UV® Commercial Series normal output one and two year UVC lamps are available in three sizes: 32" 46" and 60". In most situations two year lamps offer better value and are recommended. High output lamps (generally used for airborne not surface disinfection) are available only as a one year 32" lamp (specify 120 or 230 VAC). Optional Teflon® coating is available for all lamps (add –TF at the end of part number). Choose normal output lamps for surface and air treatment or high-output lamps for intensive air treatment.

Power Supplies

All Fresh-Aire UV® Commercial Series products come with our heavy-duty water-resistant power supply(s). Power supplies are cased in high quality NEMA enclosures.





Commercial UVC System Configuration Guidelines

Systems

Standard Commercial UV (TUVC-xx)

The basic kit includes high-quality water-resistant lamps, convenient "L" mounting brackets, and a heavy-duty multi-voltage water-resistant power supply which comes with a lifetime warranty.







Standard Commercial UV

Tubular Rack System (TUVC-TRS-xx)

The TRS System uses standard off-the-shelf ½ EMT tubing (not included) as a fully customizable framework for the UV lights. The kit includes specialised stainless steel mounting hardware as well as the lamps and power supply(s). Add optional lamp shields, 12" coil stand-offs, and vertical support as needed.




APCO® Rack System

APCO® Rack System (TUVC-APCO-xx)

The APCO® Rack System is similar to the TRS System and uses standard off-the-shelf ½ EMT tubing (not included) as a fully customizable framework for the UV lights. In addition, the kit includes our award-winning APCO® activated carbon cells, a laboratory-proven PCO air treatment technology which reduces airborne odors and toxic VOCs.

APCO® cell elements are available in sizes 32", 46", and 60" to fit the three lamp sizes. The kit includes APCO® cell elements, specialised stainless steel mounting hardware, lamps and power supply(s). Add 12" coil stand-offs, and vertical supports as needed.

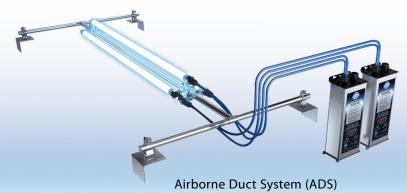

Airborne Duct System (TUVC-ADS-xx)


The ADS System is designed for air-stream disinfection and typically uses high-output lamps. These systems can be custom-configured with up to six lamps. Everything necessary for installation is included in the kit.



Commercial UVC System Configuration Guidelines

Part Numbers

Fresh-Aire UV® parts numbers start with our manufacturers designation, TUVC (Triatomic UV Commercial) followed by the system type (TRS, APCO, ADS Etc.). Next is lamp info: the first digit is 1 or 2 for longevity in years followed by lamp length in inches. The last character represents the number of lamps. The Airborne Duct System also has a designation for power supply voltage, 120 or 230 VAC.

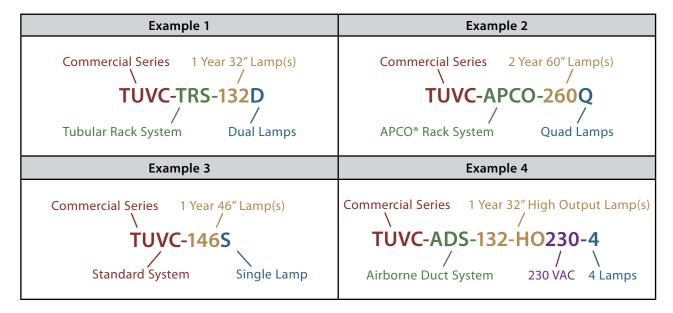

Sizing for Coil Applications

First, determine the dimensions of the coil to be irradiated. Measure the height and width of the coil on the leaving end of the air handler. UVC Lamps are typically mounted on the supply side of the coil because this cool moist environment is prone to microbial contamination. If you cannot gain access to the air handler to take measurements just send us the air handler model number so we can research it to find the dimensions.





Commercial UVC System Configuration Guidelines

System Configuration Examples

Once you have coil dimensions, determine which Fresh-Aire UV lamps will most effectively irradiate the surface of the coil by using the following rules and guidelines.

Example 1

Coil dimensions: 50"W x 32"H One 46" Lamp would fit perfectly Part Number TUVC-TRS-260

The distance from the lamp end to the coil end should not exceed 6"

Example 2

Coil dimensions: 59"W x 32"H Overlap two 32" lamps. Part Number TUVC-TRS-232D

A single 60" lamp would not be guite long enough

Example 3

Coil dimensions: 59"W x 40"H

This unit would call for (2) rows of (2) 32" lamps.

Part Number TUVC-TRS-232Q


A second row is added when the height of the coil exceeds 35".


Example 4


Coil dimensions: 150"W x 50"H


This unit would call for (3) rows of (3) 46" Lamps.

Part Numbers TUVC-TRS-246D Qty. (4) and TUVC-TRS-246S Qty. (1) A third row is added when coil height exceeds 72" It is ok to have up to 12" of spacing between lamps. Make sure lamps are evenly placed, in this scenario there would be a row every 24".



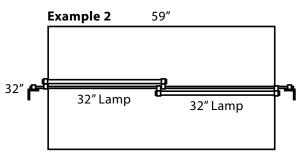

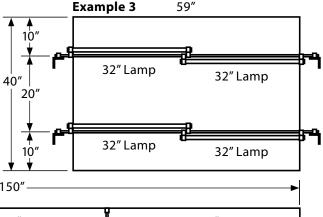

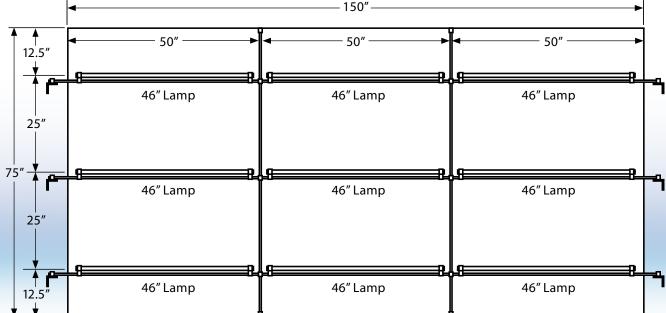



Commercial UVC System Configuration Guidelines

Accessories

Fresh-Aire UV has everything you need to make your commercial UVGI installation a success including a wide variety of accessories. Our commercial sales representatives can help you find all the right parts.

	PART NUMBER	FRESHAIRE UV PRODUCT
A	TUVC-P	Factory wired power supply panel kit w/ surge suppressor
ß	TUVC-CBX	UVGI control box with timers, lamp life, interlock switches
G	TUVC-VP-D	Large Commercial Viewport
0	TUVC-SHIELD-32	Lamp Shield 32"
3	TUVC-SHIELD-46	Lamp Shield 46"
Ø	TUVC-SHIELD-60	Lamp Shield 60"
G	TUVC-CMBRKT	12" Coil Mount Bracket
0	TUV-STR1/2	Strain Relief fitting - 1/2"
0	TUV-STR3/4	Strain Relief fitting - 3/4"
0	TUV-STR1	Strain Relief fitting - 1"
0	TUV-CBL5	5 foot remote mounting cable
0	TUV-CBL10	10 foot remote mounting cable
M	TUVC-INTLCK	Door Interlock Switch Kit
0	TUVC-LBRKT	L-Bracket
0	TUVC-LBRKTMG	L-Bracket w/ Magnet
0	TUVC-MNTR	UVC- Radiometer
0	TUVC-VS	Vertical Support kit





Commercial UVC System Configuration Guidelines

Questions To Ask Before Sizing A Project:

1. Describe current coil condition: Clean Moderately Clean Moderately Dirty Dirty			
2. Primary Reason for Installing these products: Energy Savings Maintenance IAQ			
3. AHU system TYPE (check all that apply): DX Chilled water Roof Top Package Unit			
4. Air Handler/FanCoil type: Manufacturer Model #			
5. What are the dimensions of the coil in inches? Width Height Depth Depth			
6. Is the coil a single unit or several stacked coils? Yes No			
6B. If YES: Number Of Coils Width Height Depth			
6C. Number of extended drain pans			
7. Are belts, wires, rubber materials or filters within 12" of cooling coil? Yes No No 8. Is 12" Available between to Coil and Blower? Yes No 9. Available voltage? 120 VAC 208/230 VAC 277 VAC Other?			
10. Is odor/VOC control a concern? Yes No 10B. If yes: Type of Odor Fresh Air % CFM			
11. Is this an IAQ critical area requiring high output duct irradiation? 11B. If yes: Duct Material Duct Length			
12. Is there an installed UVGI system? Yes No			
13. Who will perform Installation? Subcontractor In-House Staff			



800-741-1195